

# (1) TYPE EXAMINATION CERTIFICATE



- (2) Equipment and Protective Systems intended for use in Potentially Explosive Atmosphere - **Directive 2014/34/EU**
- (3) Type-Examination Certificate Number

**TÜV 22 ATEX 8929 X**

Issue: 00

- (4) **Equipment:** Surge Protector type DG M TT 2P 275 xx and DG M TN 275 xx
- (5) **Manufacturer:** DEHN SE
- (6) **Address:** Hans-Dehn-Str. 1  
92318 Neumarkt, Germany

- (7) This product and any acceptable variation thereto are specified in the schedule to this certificate and the documents therein referred to.
- (8) The TÜV Rheinland Zertifizierungsstelle für Explosionsschutz of TÜV Rheinland Industrie Service GmbH, in accordance with Article 21 of the Council Directive 2014/34/EU of 26<sup>th</sup> February 2014, certifies this product which has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of equipment and protective systems intended for use in potentially explosive atmosphere, given in Annex II to the Directive.

The examination and test results are recorded in the confidential report 557/Ex8929.00/22

- (9) Compliance with the Essential Health and Safety Requirements, with the exception of those listed in the schedule of this certificate, has been assessed by reference to:

**EN IEC 60079-0: 2018**

**EN 60079-7: 2015**

**EN IEC 60079-7:2015/A1:2018**

- (10) If the sign "X" is placed after the certificate number, it indicates that the equipment is subject to special conditions for safe use specified in the schedule to this certificate.
- (11) This Type Examination Certificate relates only to the design and specification for construction of the equipment or protective system. It does not cover the process for actual manufacture or supply of the equipment or protective system, for which further requirements of the directive are applicable.
- (12) The marking of the equipment shall include the following:




**II 3 G Ex ec IIC T4 Gc**

TÜV Rheinland Zertifizierungsstelle für Explosionsschutz

Cologne, 04.05.2023

Dipl.-Ing. Christian Menrhoff

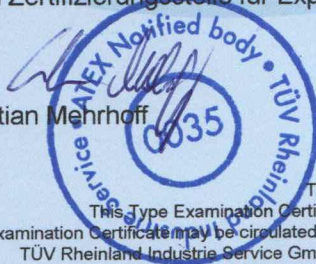

This EU-Type Examination  
This Type Examination Certificate without signature and stamp shall not be valid.  
This Type Examination Certificate may be circulated only without alteration. Extracts or alterations are subject to approval by the  
TÜV Rheinland Industrie Service GmbH TÜV Rheinland Group Am Grauen Stein 51105 Köln  
Tel. +49 (0) 221 806-0 Fax. + 49 (0) 221 806 114

(13)

Annex

(14)

## Type Examination Certificate

### TÜV 22 ATEX 8929 X

Issue: 00

(15) Description of equipment

## 15.1 Equipment and type:

Surge Protector DG M TT 2P 275 xx and DG M TN 275 xx

DG M	Tx xx	275	xx
	1	2	3

1	TN, TT 2p = Network configuration
2	275 = highest permissible system voltage in V
3	FM = optional for variant with remote contact

## 15.2 Description / Details of Change

The DG M TT 2P 275 xx and DG M TN 275 xx surge protections are used in circuits to protect the connected equipment from high-energy transient over voltages.

The surge protectors are intended for the following applications:

The modular 2-pole surge protection devices are used for equipment protection in electrical power systems in circuits with increased safety in zone 2.

The DG M TT 2P 275 xx and DG M TN 275 xx are modular surge protective devices consists of a base part and two plug-in protection modules.

Following parts are existent

Base part	Modules
DG M TN 275 (FM)	DG MOD 275
DG M TT 2P 275 (FM)	DG MOD NPE

They are used in following configurations:

Equipment	Pflug-in Modules	
	DG MOD 275	DG MOD NPE
DG M TT 2P 275 (FM)	1x	1x
DG M TN 275 (FM)	2x	---

This EU Type Examination Certificate without signature and official stamp shall not be valid.  
 This certificate may be circulated without alteration. Extracts or alterations are subject to approval by:  
 Zertifizierungsstelle of TÜV Rheinland Industrie Service GmbH

Technical Data

**Electrical data**

Type:	Umax
DG M TT 2P 275 FM	275 V
DG M TT 2P 275	275 V
DG M TN 275 FM	275 V
DG M NP 275	275 V

**Environmental data**

Ambient temperature range  $-40\text{ °C} \leq T_a \leq +80\text{ °C}$

(16) Test-Report No. 557/Ex8929.00/22

(17) Special Conditions for safe use

1. The equipment shall only be used in an area of at least pollution degree 2, as defined in IEC 60664-1.
2. The equipment shall be installed in an enclosure that provides a minimum ingress protection of IP54 in accordance with IEC 60079-0.
3. The environmental data must be taken into account – see electrical data above and the operating instructions
4. Ambient temperature range  $-40\text{ °C} \leq T_a \leq +80\text{ °C}$


(18) Basic Safety and Health Requirements

Covered by afore mentioned standard

TÜV Rheinland Zertifizierungsstelle für Explosionsschutz

Cologne, 2023-05-04

Dipl.-Ing. Christian Mehnhoff

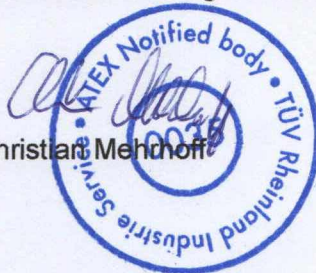

This EU Type Examination Certificate without signature and official stamp shall not be valid.  
This certificate may be circulated without alteration. Extracts or alterations are subject to approval by:  
Zertifizierungsstelle of TÜV Rheinland Industrie Service GmbH