

VOLTMETRE

EVM-3 / EVM-3C

Güvenli Kullanım ve Kurulum İçin Uyarılar

Aşağıdaki talimatlarla uyulmaması halinde yaralanma veya ölümlerle sonuçlanabilecek durumlar ortaya çıkabilir.

- Cihaz üzerindeki herhangi bir işlemten önce tüm besleme gerilimlerini kesin.
- Cihaz şebekeye bağlı iken ön paneli çıkarmayınız.
- Cihazı solvent veya benzeri maddelerle temizlemeyiniz. Cihazı temizlemek için sadece kuru bez kullanınız.
- Cihazı çalıştırmadan önce bağlantılarının doğru olduğunu kontrol ediniz.
- Cihazı panoya önden takınız.
- Cihazınızdaki herhangi bir sorunda yetkili satıcınızla temas kurunuz.

Yukarıdaki önlemlerin uygulanmaması sonucu doğabilecek istenmeyen durumlardan üretici firma hiç bir şekilde sorumlu tutulamaz.

EVM-3: (Voltmetre) Herhangi iki nokta arasındaki AC gerilimin RMS değerini hassas bir şekilde ölçmek, ölçtüğü minimum ve maksimum değerleri kaydetmek için tasarlanmıştır. Minimum ve maksimum değerleri besleme gerilimi kesildiğinde kaybolmaz, besleme tekrar geldiğinde kaldığı yerden kaydetmeye devam eder. Bütünyle elektronik yapıda olan EVM-3, en çok elektrik panolarında kullanılmakla birlikte 10-600V aralığında ölçüm yapılmak istenilen her uygulama için de kullanılabilir. Ölçme (3-4) ve besleme (1-2) girişleri, EVM-3'ün arka panelinde yer almaktadır ve dijital göstergesi de ön panelinde bulunmaktadır.

EVM-3C: (Setpointli Voltmetre) Herhangi iki nokta arasındaki AC gerilimin RMS değerini hassas bir şekilde ölçer, ölçülen gerilim, ön paneldeki tuşlar yardımıyla ayarlanan aşırı setpointi geçince veya düşük setpointin altına düşünce belirlenen gecikme zamanı sonunda çıkış rölesi çekerek hata sinyali verir. Gerilim normal aralığına dönünce belirlenen gecikme süresi sonunda çıkış rölesi bırakır. Bunun yanında EVM-3' ün tüm özelliklerine sahiptir.

Not: Cihazın yaptığı ölçümün veya girilecek primer değerinin 9999 V'u aşması durumunda ön paneldeki "k" LEDi yanar.

Not: Cihazın ölçme girişine uygulanan gerilimin 600 V'u geçmesi veya ayarlanan primer/sekonder oranına göre alınan ölçümün 999.900 V'u aşması halinde displayde "h" yazısı görünür.

Gerilim Trafo Oranı: Gerilim trafosunun, primer ve sekonder gerilim değerleri ayrı ayrı ayarlanabilir. Primer değeri 1-40000 arasında, Sekonder değeri ise 1-250 arası bir değer girilebilir.

Not: Primer veya sekonder değeri değiştirildiğinde, setpoint değerlerini ve histeresis değerini kontrol ediniz. Bu işlem cihazın ayarlanan şekilde çalışması açısından önemlidir.


Minimum ve Maksimum Gerilim: Ölçme esnasında minimum ve maksimum gerilimler kaydedilir. Bu değerler istendiğinde kullanıcı tarafından görülebilir veya silinebilir. Kaydedilen değerler cihazın beslemesi kesildiğinde kaybolmaz, besleme tekrar geldiğinde kaldığı yerden kaydetmeye devam eder.

Setpoint (5 P h ve 5 P L) : Cihazın ölçme girişinden, ayarlanan aşırı setpoint değerinden daha büyük yada düşük setpoint değerinden küçük bir gerilim ölçülürse ayarlanan hataya geçme süresi sonunda çıkış rölesi çekerek uyarı sinyali verir (Displayin sağ alt köşesinde nokta yanıp söner). Süre dolmadan gerilim değeri normal aralığa dönerse cihaz bir sonraki arıza gerilimine kadar normal çalışmasına devam eder.


Latch fonksiyonu (L R E C) : Çıkış rölesinin çalışma şeklini belirler. "oF" seçilmişse cihaz hata durumundan normal duruma döndüğünde çıkış rölesi bırakır. "on" seçilmişse cihaz normal duruma dönerse bile çıkış rölesi çekili kalmaya devam eder. Ancak set tuşuna basarak bırakması sağlanır.

Ani Açma Fonksiyonu (t r P) : Gerilim aşırı setpoint değerinin 1.5 katını geçtiğinde yada düşük setpoint değerinin 0.5 katından aşağı düştüğünde çıkış rölesi gecikmesiz olarak çeker. Bu fonksiyonun çalışması kullanıcı tarafından seçilebilir.


Gerilim Trafosu Primer Değerinin Ayarlanması (EVM-3C için)

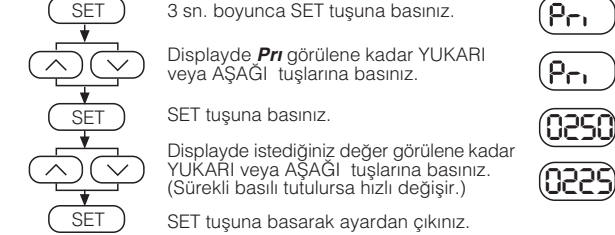


Gerilim Trafosu Sekonder Değerinin Ayarlanması (EVM-3C için)

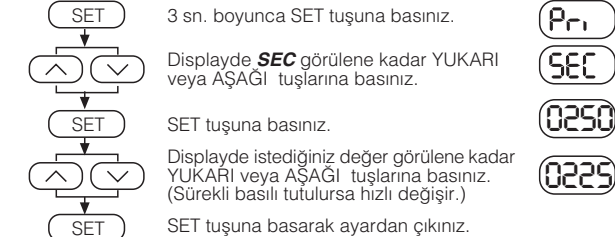


Aşırı Setpoint Değerinin Ayarlanması (EVM-3C için)

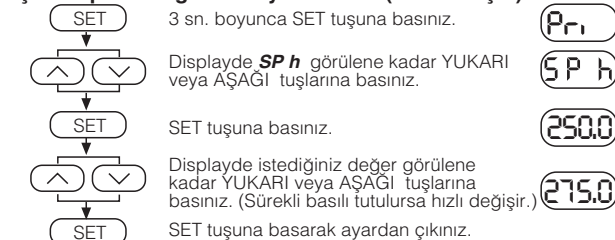


Düşük Setpoint Değerinin Ayarlanması (EVM-3C için)

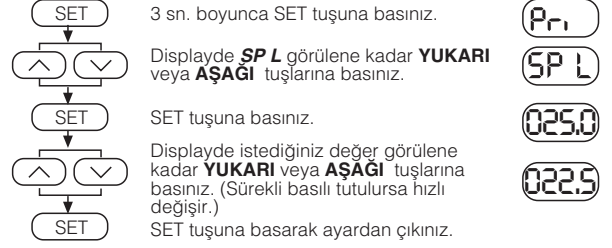


Histeresis Ayarı (EVM-3C için)

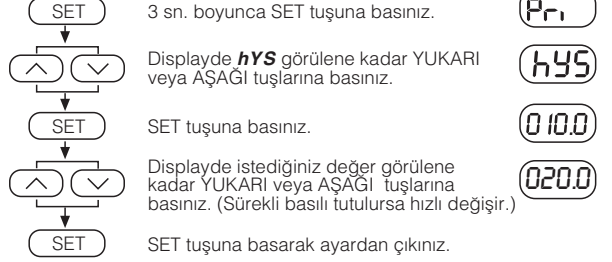


Hataya Geçme Gecikmesi Ayarı (EVM-3C için)

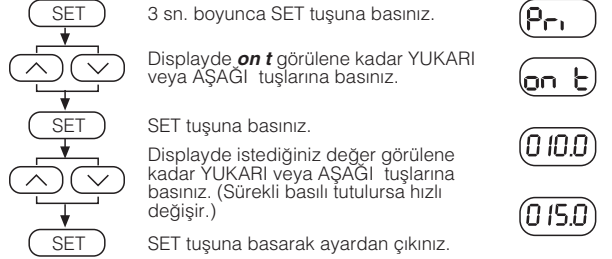


Normale Dönme Gecikmesi Ayarı (EVM-3C için)

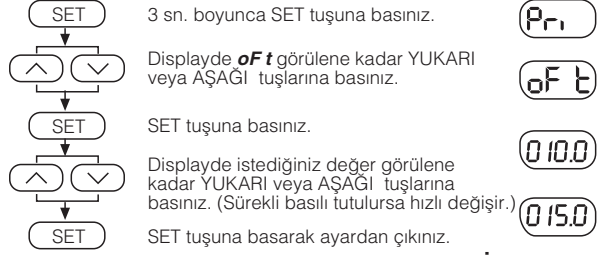


Ani Açma Fonksiyonunun Ayarlanması (EVM-3C için)

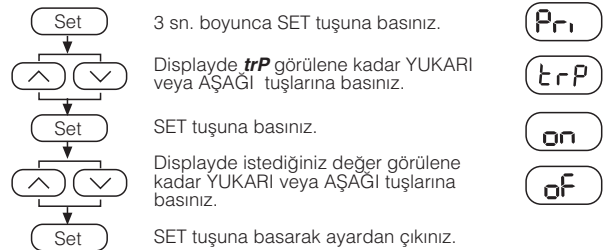

Latch Fonksiyonunun Ayarlanması (EVM-3C için)

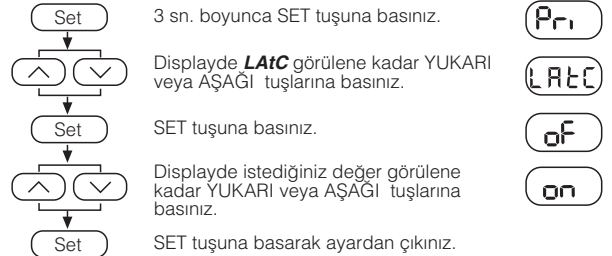


Açma Sayısının Görülmesi ve Silinmesi (EVM-3C için)

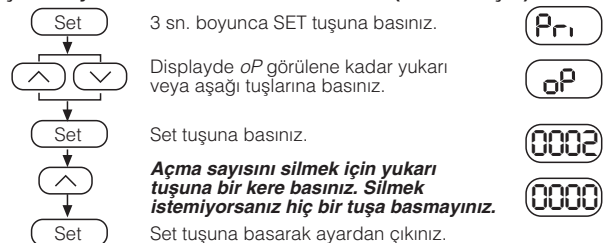


VOLTMETRE EVM-3 / EVM-3C


Kontak Durumunun Ayarlanması (EVM-3C için)

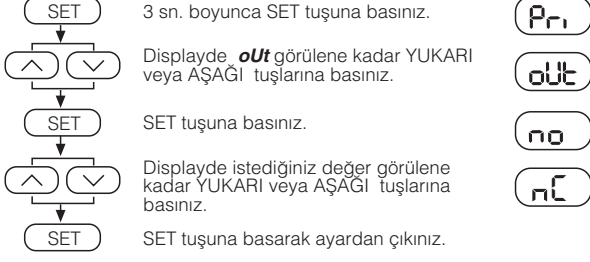


Ayar Menüden Çıkma (EVM-3C için)

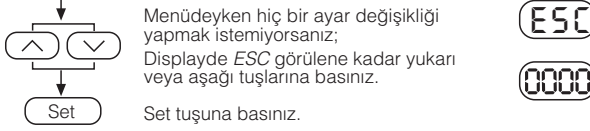


Minimum Gerilimin Görülmesi



Maksimum Gerilimin Görülmesi



Minimum ve Maksimum Değerlerin Silinmesi

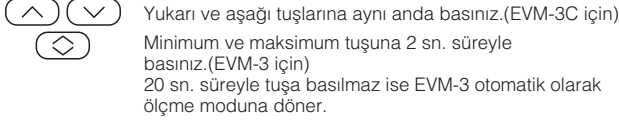


Minimum ve maksimum değerler gösterilirken ondalık nokta yanıp söner (EVM-3 için).

Fabrika Ayarları :

Gerilim trafosu primer değeri (PR1)	: 0100
Gerilim trafosu sekonder değeri (SET)	: 0100
Aşırı set point değeri (SP H)	: 250.0
Düşük set point değeri (SP L)	: 150.0
Histerisis değeri (hys)	: 010.0
Hataya geçme gecikmesi (on t)	: 010.0
Hatadan dönme gecikmesi (of t)	: 010.0
Ani açma fonksiyonu değeri (trP)	: on
Latch fonksiyonu (LATCH)	: of
Kontak durumu (out)	: no (Normalde açık)


Bağlantı Şemaları

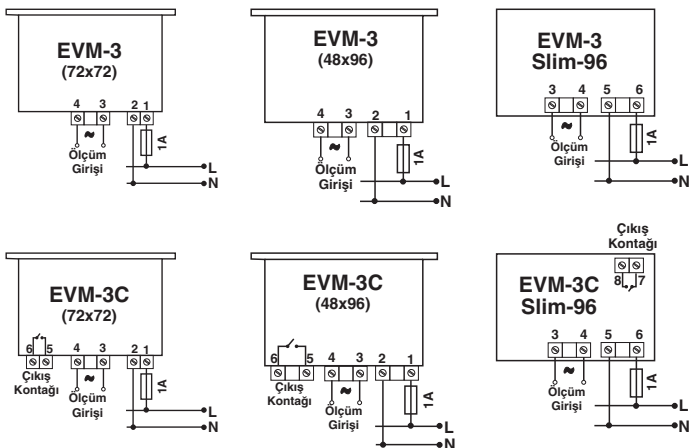


Uyarılar :

- Şebeke ve cihazın besleme girişleri arasında bir buton devre kesici bağlayınız.
- Bağlanan buton veya devre kesici cihaza yakın olmalıdır.
- Bağlanan buton veya devre kesicinin, cihazı şebekeden ayırmak için kullanılacağı işaretlenmelidir.
- Kullanılan sigortalar FF tipi ve 1A değerinde olmalıdır.
- Jeneratörle kullanmayınız.
- Pratik Kullanım Kılavuzunu panoya yapıştırınız.
- Soğutma için vantilatör vb. gerekmez.


Boyutlar

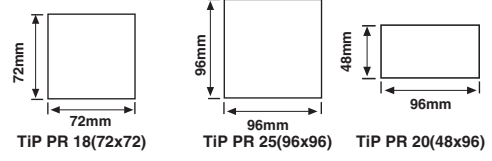

Kontrol Panel Alan Ölçüsü

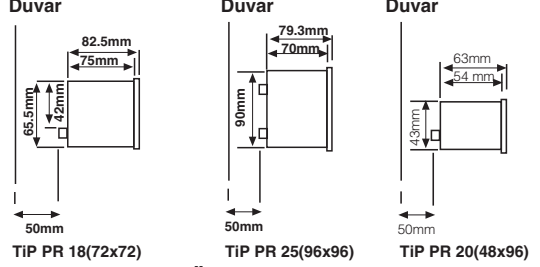

Kontrol Panel Kesim Ölçüsü

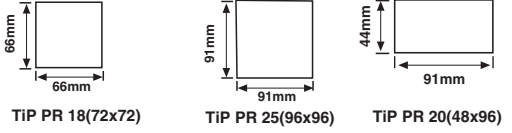

Teknik Özellikler

Besleme Gerilimi (U_N)*

Çalışma Aralığı (ΔU)

Çalışma Frekansı (f)

Sınıf

Ölçme Girişi (V_{IN})

Güç Tüketimi (P_{cons})

Ölçme Girişi Güç Tüketimi

Çıkış Kontakı

Gerilim Trafosu Oranı

Primer

Sekonder

Ani Açma

Histerisis

Gecikme Zamanı

Gösterge

Ekipman Koruması

Ortam Sıcaklığı

Koruma Sınıfı

Kurma

Kablo Kesiti (Klemens için): 2.5 mm²

Boyutlar

Ağırlık

: Lütfen cihaz etiketlerine bakınız.

: 45-65 Hz

: %1±1 dijital [(%10-%100) tam skala]

: 10-600 V AC (EVM-3, EVM-3C için)

: <4 VA

: <1 VA

: 5 A, 250 V, 1250 VA (Rezistif) (EVM-3C için)

: 1-40000 (EVM-3C için)

: 1-250 (EVM-3C için)

: >1.5 x SP H veya <0.5 x SP L (EVM-3C için)

: 0-0.5 x tam skala (EVM-3C için)

: 0.0 - 999.9 sn. (EVM-3C için)

: Kırmızı LED Gösterge

: Çift izolasyonlu (□), Ölçme Kategorisi III

: -5 °C; +50 °C

: IP 40 (Ön Panel)

: Panoya önden

: 2.5 mm²

: TİP PR 18, TİP PR 25, TİP PR 20

: 0.28 kg (PR 18 için)

: 0.30 kg (PR 25 için)

: 0.25 kg (PR 20 için)

Paketleme Bilgisi

Kolideki Cihaz Sayısı	: 16 Adet (PR 18 için)
Koli Ağırlığı	: 4.5 kg
Kolideki Cihaz Sayısı	: 12 Adet (PR 25 için)
Koli Ağırlığı	: 3.6 kg
Kolideki Cihaz Sayısı	: 20 Adet (PR 20 için)
Koli Ağırlığı	: 5 kg



* Lütfen cihaz etiketlerine bakınız.

* İstenildiğinde değişik besleme gerilimi değerleri sağlanabilir.

"Bu ürün, 30.05.2008 tarih ve 26891 sayılı resmî gazetedeki yayımlanan EEE Yönetmeliğinin Madde 2 ve Ek-1A madde 9 kapsamındadır."



VOLTMETER

EVM-3 / EVM-3C

Precautions For Installation and Safe Use

Failure to follow those instructions will result in death or serious injury.

- Disconnect all power before working on equipment.
- When the device is connected to the network, do not remove the front panel.
- Do not try to clean the device with solvent or the like. Only clean the device with a dried cloth.
- Verify correct terminal connections when wiring.
- Electrical equipment should be serviced only by your competent seller.
- Only for rack panel mounting.

⚠ No responsibility is assured by the manufacturer or any of its subsidiaries for any consequences arising out of the use of this material.

EVM-3 (Voltmeter) :

EVM-3 is designed for accurate measuring of the AC RMS voltage and for saving the minimum and maximum values of the measured voltages. Minimum and maximum values remain stored in the memory when the power supply is off. This stored values can be read when the power is on. Although EVM-3 is mainly used for electrical panels, this device can also be used with any application in which accurate voltage readings should be done between 10-600V. The measurement (3-4) and power supply (1-2) connections are located on the rear panel and the digital display is centered on the front panel.

EVM-3C (Setpoint Voltmeter) :

EVM-3C has the same functions of the EVM-3. In addition to these functions, an high voltage level and "time delay" can be set. When the measured voltage is over the high set point value, the output relay is activated at the end of the adjusted time delay, generates an alarm signal and display starts blinking.

Note: If the measurement that the device made or the primary value is over 9999 V, k led on the device is on.

Note: If the voltage on the measurement input of the device is over 600 V or measurement according to the ratio of entered primary/secondary is over 999.000 V, there will be "h" on the display.

Voltage Transformer Ratio: Voltage transformer can regulate the primary and secondary voltage values separately. Primary value can be entered between 1-40.000 and the secondary value can be entered between 1-250.

Note: If the primary and secondary values changed, control the setpoint and hysteresis values. This is important for the device working the way that it was arranged.

Minimum and Maximum Voltage :

The minimum and maximum voltage values are stored. User may read or delete these values. Stored minimum and maximum voltage values remain stored, when the power supply is off.


Setpoint (SP h ve SP L): When the AC current which flows through the device is over the high setpoint value or it is under the low setpoint value, the output relay is switched on in order to generate an error signal at the end of programmed delay time (The point which is on the below right corner of display blinks). If the AC current value returns within preset limits, before the end of the delay time, the relay resets itself and no tripping occurs.

Latch Function (Latch) : Latch function is used to select the output relay operation mode. Either "oF" or "on" position may be selected.


- At position "oF": If the current value returns to preset limits, output relay is switched off.
- At position "on": Even if the current value returns to preset limits, output relay remains switched on and switches off only by pressing the "Set" button.

Instant Tripping (t r P) : If the AC current value is over the 1.5 times of setting value or it is under the 0.5 times of setting value, the output relay is switched on without any delay time. This function is user-selectable.


Setting of Voltage Transformer Primary Voltage Value (for EVM-3C)

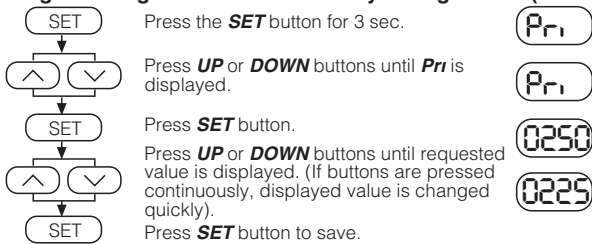


Setting of Voltage Transformer Secondary Voltage Value (for EVM-3C)

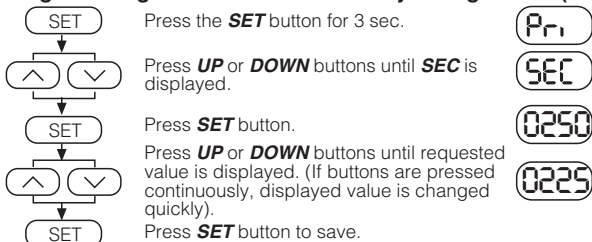


Setting of High Setpoint Value (for EVM-3C)

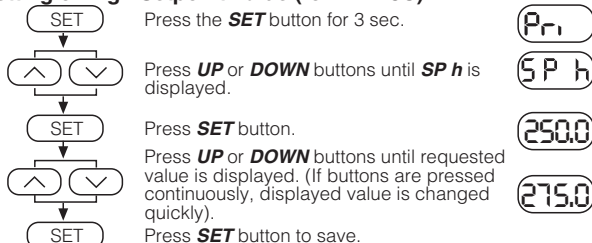


Setting of Low Setpoint Value (for EVM-3C)

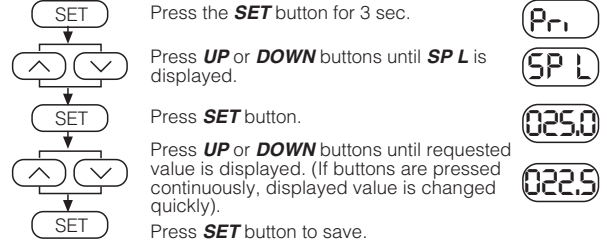


Setting of Hysteresis Value (for EVM-3C)

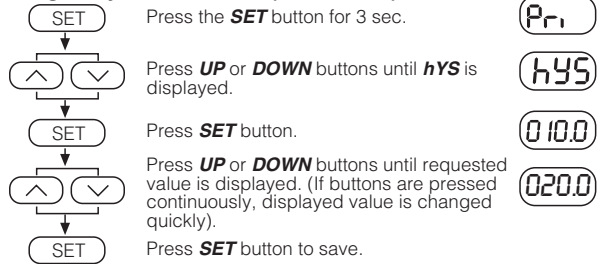


Setting of On Time Value (for EVM-3C)

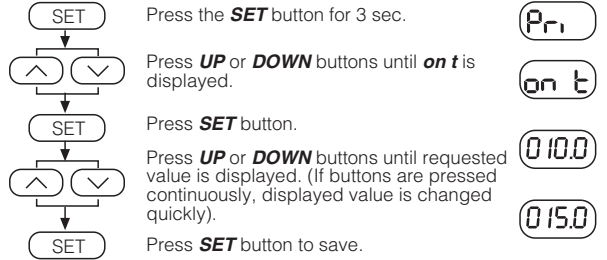


Setting of Off Time Value (EVM-3C için)

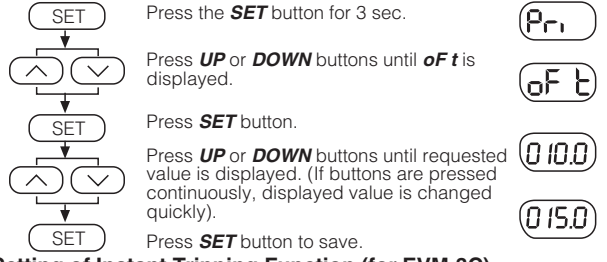


Setting of Instant Tripping Function (for EVM-3C)

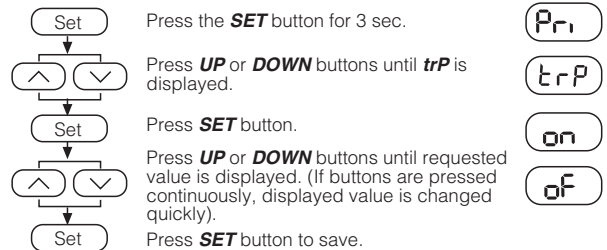

Setting of Latch Function (for EVM-3C)

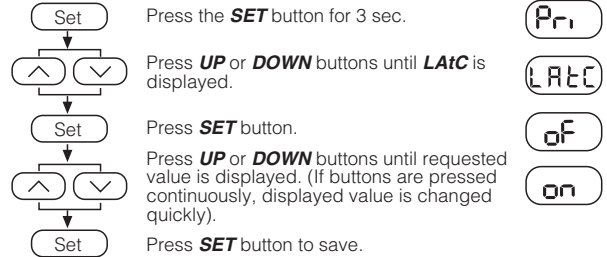


Displaying and Deleting Tripping Number (for EVM-3C)

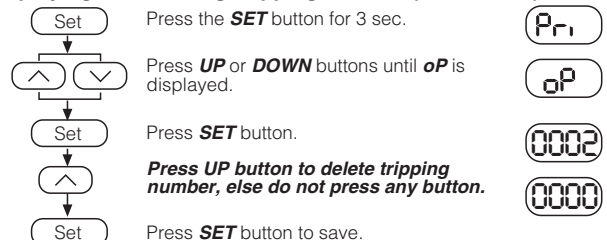

VOLTMETER EVM-3 / EVM-3C

Setting of Contact Situation (for EVM-3C)

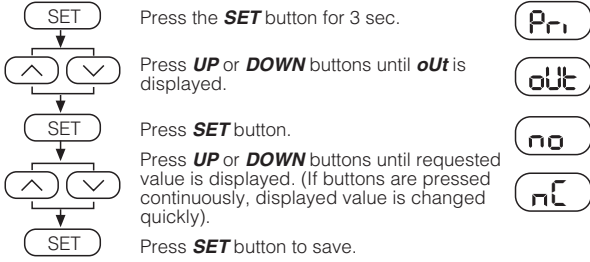

Escaping the Set Menu (for EVM-3C)




Displaying Minimum Voltage



Displaying Maximum Voltage



Deleting the Minimum and Maximum Voltages

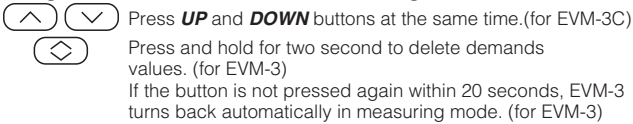


- The decimal point blinks while the display shows demand values (for EVM-3).

Factory Setting :

Voltage transformer primary voltage value (P _r)	: 0100
Voltage transformer secondary voltage value (SE _t)	: 0100
High set point value (SP _H)	: 250.0
Low set point value (SP _L)	: 150.0
Hysteresis value (h _{YS})	: 010.0
On time (on t)	: 010.0
Off time (oF t)	: 010.0
Instant tripping function (t _r P)	: on
Latch function (L _{At} C)	: oF
Contact situation (oUt)	: no (Normally open)


Connection Diagrams

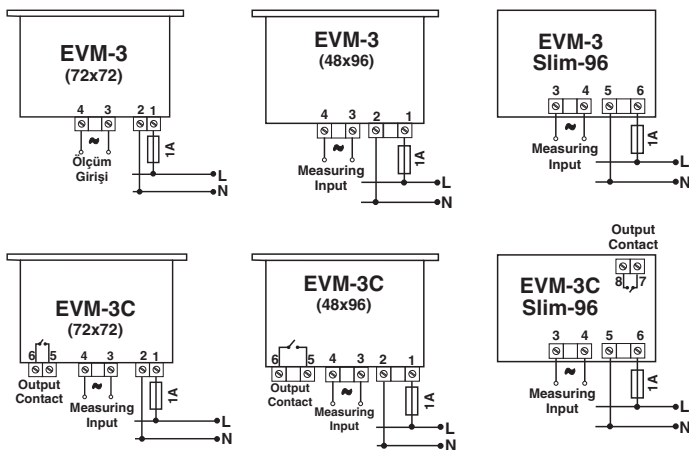


Warning :

- A switch or circuit breaker must be connected between the network and the auxiliary supply input of device.
- Connected switch or circuit breaker must be in close proximity to the device.
- Connected switch or circuit breaker must be marked as the disconnecting device for the equipment.
- The type of the used fuse must be FF type and the current of the used fuse must be 1A.
- No need of a ventilator in the installation area
- Do not use with generator.


Dimensions

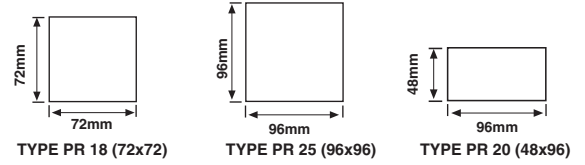

The Area Measurements on The Control Panel

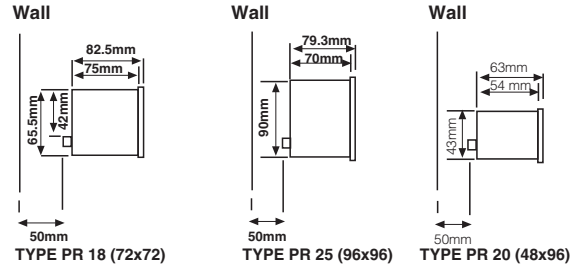

Control Panel Cut Out

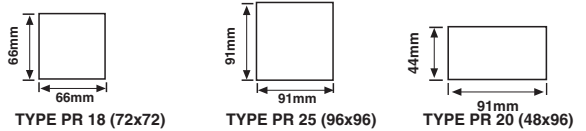

Technical Data

Operating Voltage (U _N)*	
Operating Range(ΔU)	: Please look at labels on the device.
Operating Frequency(f)	: 45-65 Hz
Accuracy	: 1% ±1 digit [(%10-%100) full scale]
Measuring Input (V _{IN})	: 10-600 V AC (for EVM-3, EVM-3C)
Power Consumption(P _{cons})	: <4 VA
Burden	: <1 VA (per phase)
Output Contact	: 5 A, 250 V, 1250 VA (Resistive) (for EVM-3C)
Voltage Transformer Ratio	
Primary	: 1-40000 (for EVM-3C)
Secondary	: 1-250 (for EVM-3C)
Ins. Tripping	: >1.5 x SPH or <0.5 x SPL (for EVM-3C)
Hysteresis	: 0-0.5 x Full scale (for EVM-3C)
Delay Time	: 0.0 - 999.9 sec. (for EVM-3C)
Enclosure	: Non-flammable
Equipment Protection	: Double Insulation (□), Measuring CategoryIII
Ambient Temperature	: -5 °C; +50 °C
Degree of Protection	: IP 40 (Front Panel)
Installations	: Flush mounting with rear terminals
Wire Cross section (for terminals):	2.5 mm ²
Dimensions	: Type PR 18, PR 25, PR 20
Weight	: 0.28 kg (for PR 18) 0.30 kg (for PR 25) 0.25 kg (for PR 20)

Packaging Information

Pcs per Package	: 16 Pcs (for PR 18)
Package Weight	: 4.5 kg
Pcs per Package	: 12 Pcs (for PR 25)
Package Weight	: 3.6 kg
Pcs per Package	: 20 Pcs (for PR 20)
Package Weight	: 5 kg



* Please check the device label for proper value.

*Different supply voltages are adjustable upon request.

